


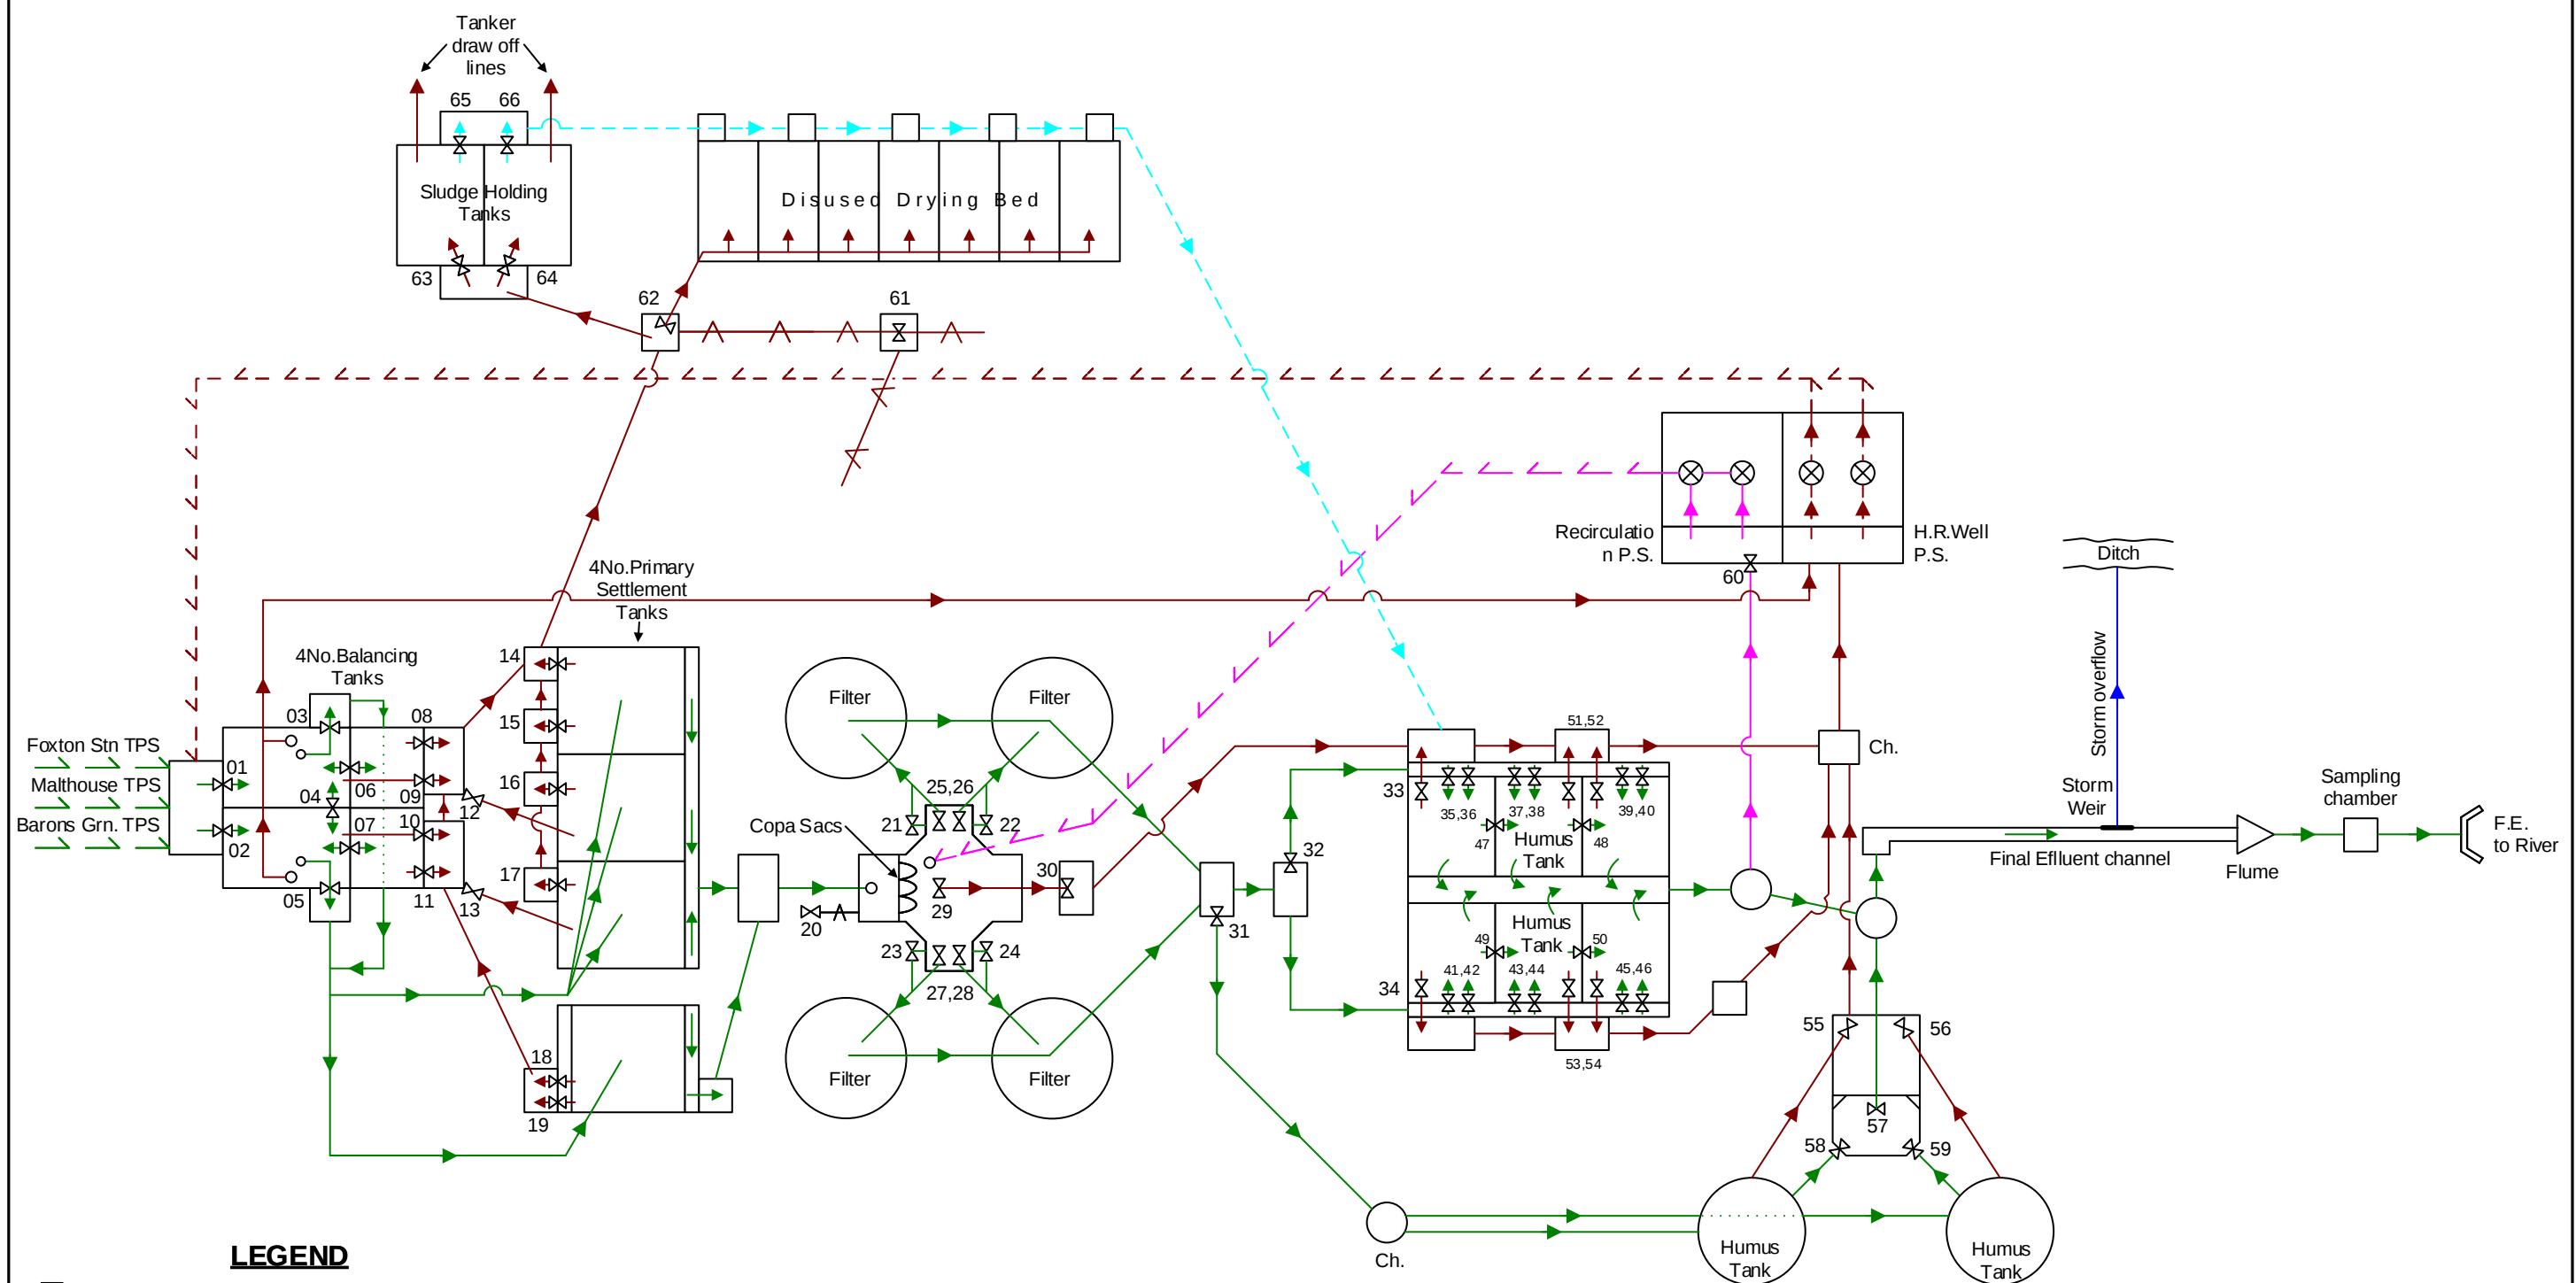

LEGEND

- X

Valve
- X

Pump
- A

Flow Recorder/Flume
- M

Screen
- X

Compactor
- M

Macerator
- M

Manhole
- A

Access Point
- M

Chamber
- M

SAS (BLACK)
- M

Bypass (Colours As Above)
- M

Normal Flow
- M

Sludge
- M

Storm
- M

Humus Return/RAS
- M

Surface Water
- M

Supernatant/Sludge Liquor
- M

Recirculation
- M

Decommissioned (Colours As Above)
- M

Direction Of Flow (Colours As Above)
- M

Pumped (Colours As Above)
- M

Electricity Transmission Line

Site Name:	Foxton STW
OCD Short Code:	FXTNST
Approved By:	
Date of Final Verification:	18.09.97
Version No. 1.0	Page No: 1 of 2

Valve Schedule

<u>Valve no.</u>	<u>Remarks</u>	<u>Action</u>	<u>Valve no.</u>	<u>Remarks</u>	<u>Action</u>	<u>Valve no.</u>	<u>Remarks</u>	<u>Action</u>
01	Isolation valve	open	23	Roding valve	close	45	Isolation valve	open
02	Isolation valve	open				46	Isolation valve	open
03	Floating arm isolation valve	open	24	Roding valve	close	47	Isolation valve	close
04	Balancing isolation valve	open	25	Isolation valve	open	48	Isolation valve	close
05	Floating arm isolation valve	open	26	Isolation valve	open	49	Isolation valve	close
06	Balancing isolation valve	open	27	Isolation valve	open	50	Isolation valve	close
07	Balancing isolation valve	open	28	Isolation valve	open	51	Sludge isolation valve	close
08	Sludge isolation valve	close	29	Drain valve	close	52	Sludge isolation valve	close
09	Sludge isolation valve	close	30	Drain valve	close	53	Sludge isolation valve	close
10	Sludge isolation valve	close	31	Isolation valve	open	54	Sludge isolation valve	close
11	Sludge isolation valve	close	32	Isolation valve	open	55	Humus sludge isolation valve	close
12	Sludge isolation valve	close	33	Sludge isolation valve	close	56	Humus sludge isolation valve	close
13	Sludge isolation valve	close	34	Sludge isolation valve	close	57	Isolation valve	open
14	Sludge isolation valve	close	35	Isolation valve	open	58	Isolation valve	open
15	Scum isolation valve	close	36	Isolation valve	open	59	Isolation valve	open
16	Scum isolation valve	close	37	Isolation valve	open	60	Recirculation isolation valve	open
17	Scum isolation valve	close	38	Isolation valve	open	61	Disused sludge valve	close
18	Sludge isolation valve	close	39	Isolation valve	open	62	Disused sludge valve	close
19	Scum isolation valve	close	40	Isolation valve	open	63	Sludge isolation valve	open
20	Disused valve	close	41	Isolation valve	open	64	Sludge isolation valve	open
21	Roding valve	close	42	Isolation valve	open	65	Decanting valve	close
22	Roding valve	close	43	Isolation valve	open	66	Decanting valve	close
			44	Isolation valve	open			

Site Name:	Foxton STW
OCD Short Code:	FXTNST
Approved By:	
Date of Final Verification:	18.09.97
Version No. 1.0	Page No: 2 of 2